

## GENERAL NOTES:

1. CONNECT ALL CIRCUITS TO PANEL B1R2A UNLESS NOTED OTHERWISE.
2. REFER TO DRAWINGS E2.10.44 AND E2.10.45 FOR 480VAC MECHANICAL EQUIPMENT FEEDER SIZES.
3. MOTORS ARE PROVIDED WITH MECHANICAL EQUIPMENT AND SHOWN FOR CLARITY ONLY.

## KEYNOTES:

- |      |  |
|------|--|
| N001 | SEE DRAWING E8.10.40 FOR ENLARGED PLAN OF THE ELECTRIC ROOM.   |
| N002 | SEE DRAWING E8.10.44 FOR POWER PLAN OF THIS AREA.  |
| N003 | CONNECT ALL CIRCUITS FOR FAN POWERED HOT WATER TERMINAL UNITS TO PANEL B1R2A. (TYP. 7)   |
| N004 | INSTALL INCANDESCENT LIGHT FIXTURE IN ELEVATOR PIT. CROSS-HATCHES FORM 300 CAT NO. 1022008 OR APPROVED EQUAL.                  |
| N005 | CONNECT ALL CIRCUITS FOR FAN COIL UNITS TO PANEL B1R2A. (TYP. 1).  |
| N006 | CONNECT 120VAC, 20A, 1 PHASE CIRCUIT FOR MECHANICAL EQUIPMENT CONTROL ENCLOSURE TO PANEL B1R2A. (ENCLOSURE PROVIDED BY OTHERS) |

H

H

G

G

F

F

E

E

D

D



C

C

B

B

CAD

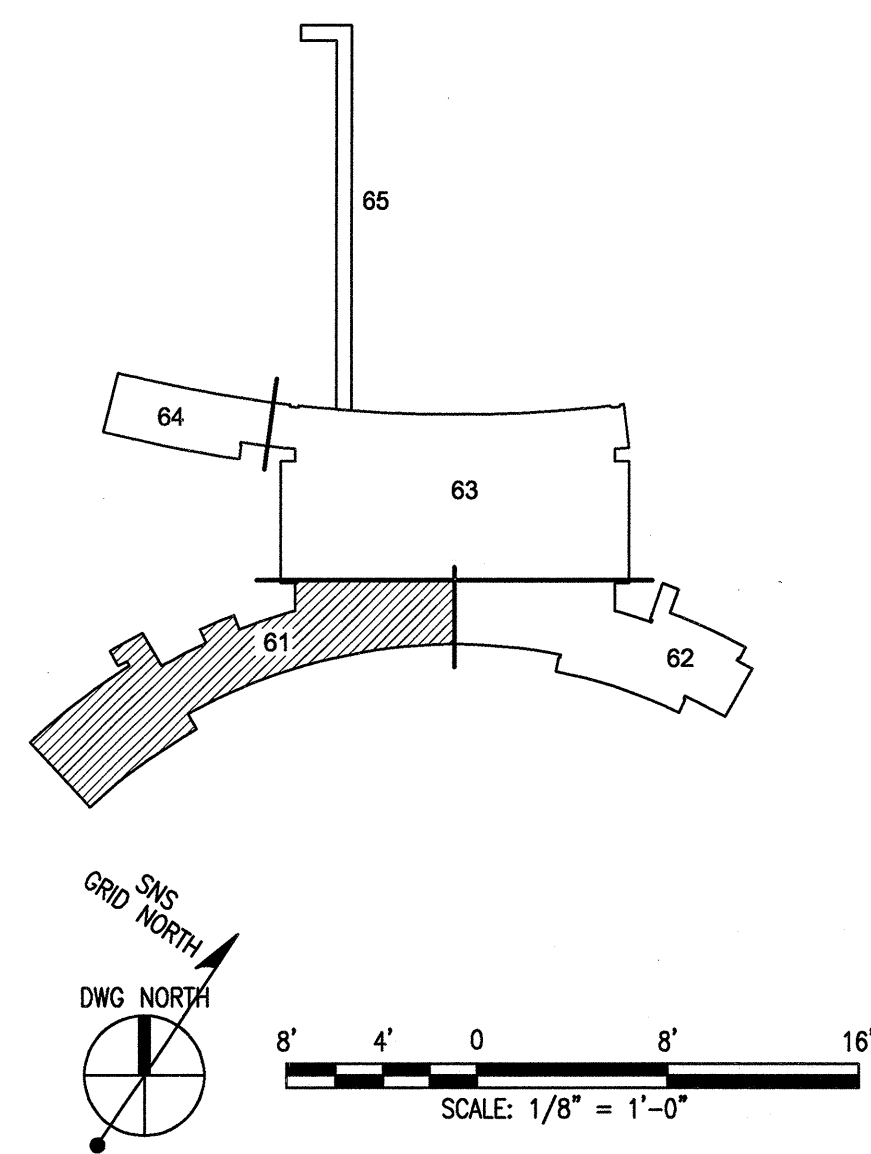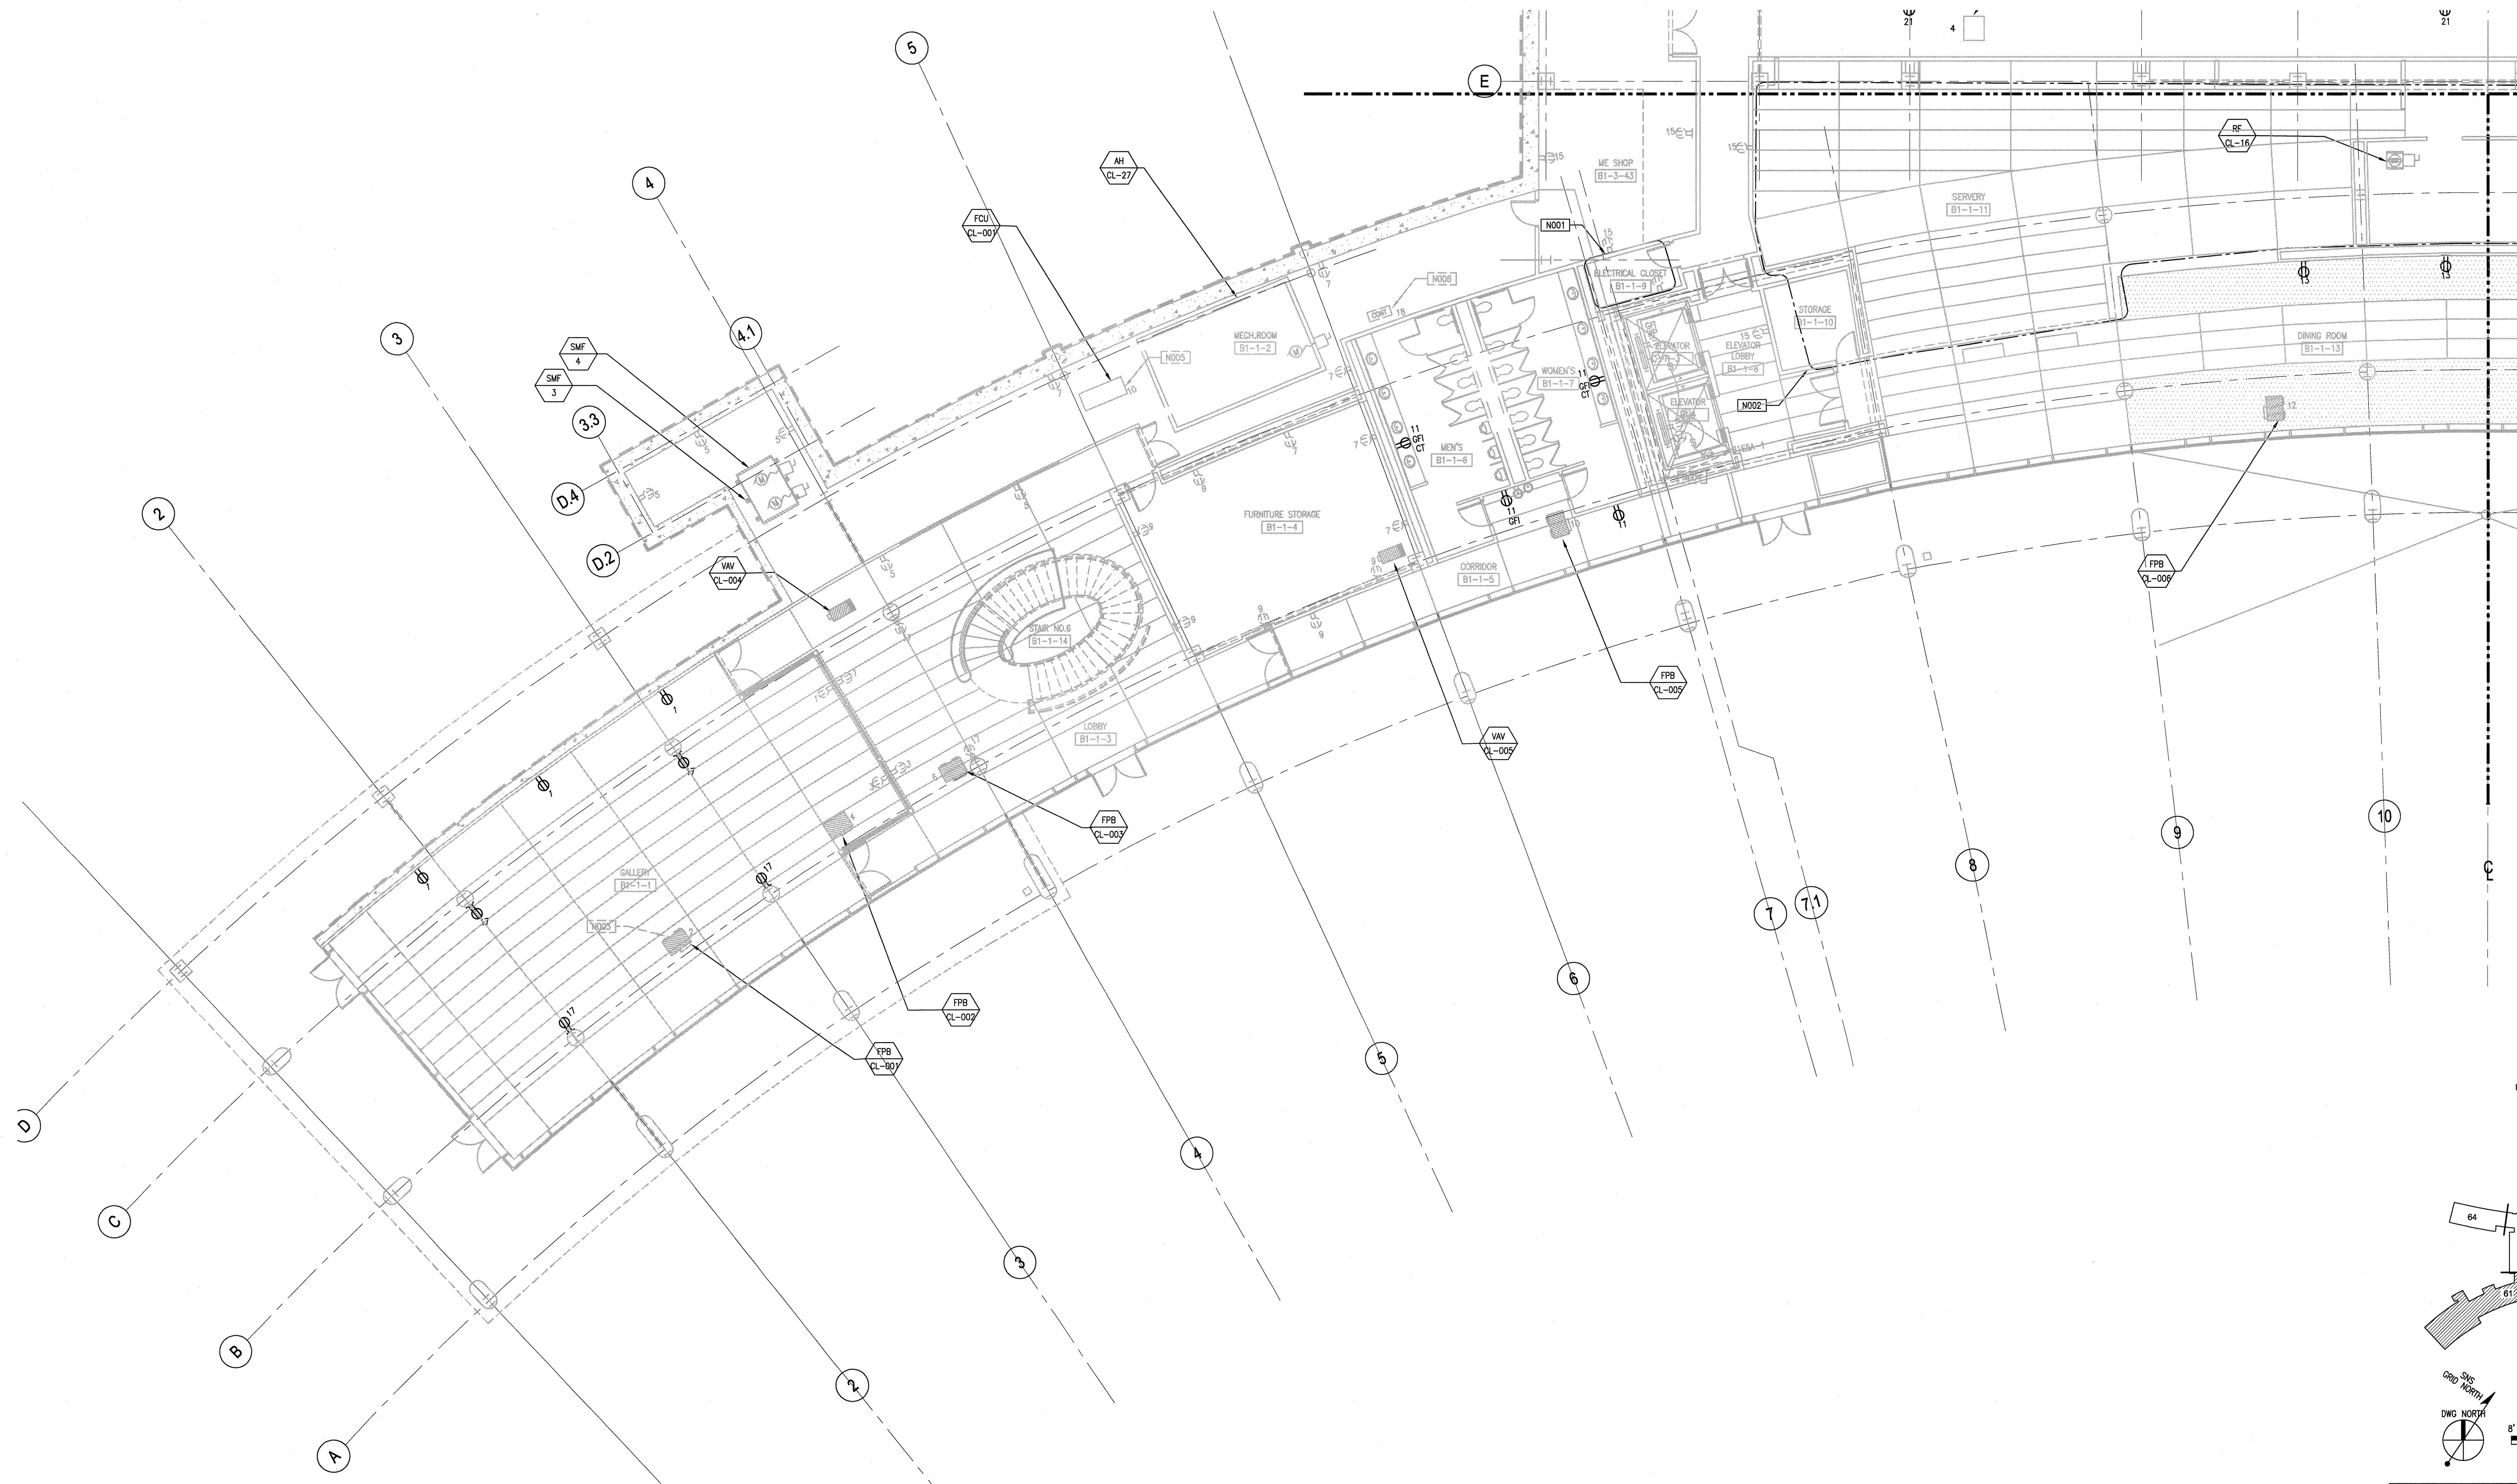


108031400-E8E-8600-A205



Knight/Jacobs Joint Venture  
701 Scenic Road, MS 8253  
Oak Ridge, TN 37830  
865-241-9433  
fax 865-241-3400

**KNIGHT**  
Knight Advanced Technology  
4710 East Drexel, Suite #1  
Phoenix, AZ 85040



DSN	D.DANIELSON	12/20/01
DRW	J. BROWN	12/20/01



Oak Ridge National Laboratory  
managed for the DEPARTMENT OF ENERGY under  
DEACON contract number DE-AC05-84OR21400